


# Example of passive and active rack loading

1. Refer to Appendix 2.3.1 for all Cabinet [MDC] Standards
2. Support and direction provided by ICT Infrastructure Team for Patch Panels
3. Support and direction provided by ICT and AV electrical and Electronic Systems (ET) for Network Switch gear

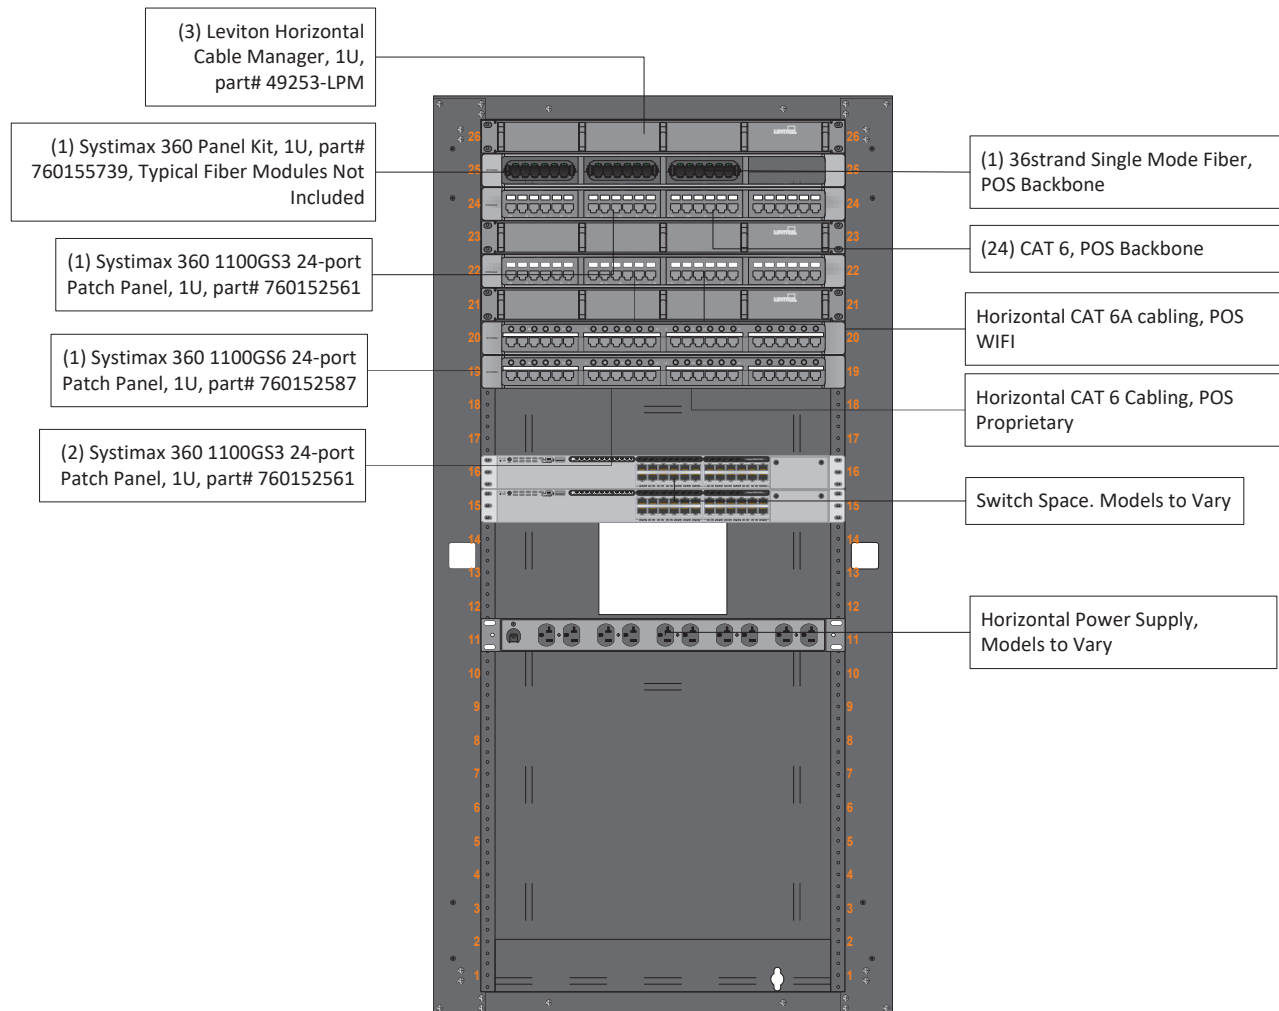

FILENAME				
MDC-TYPICAL REQUIREMENTS		RED= 2024.01.19 updates		